k of Providing and laying 100mm and 150mm dia DI water pipe line in place of 75 //100mm dia corroded CI water pipeline in 12th cross vinayakanagara,Mahadeshwara nple opp conservancy padarayanapura and surrounding areas to reduce contamination and eequent leak coming under JJR nagara service station of AEESW-2 Sub Division

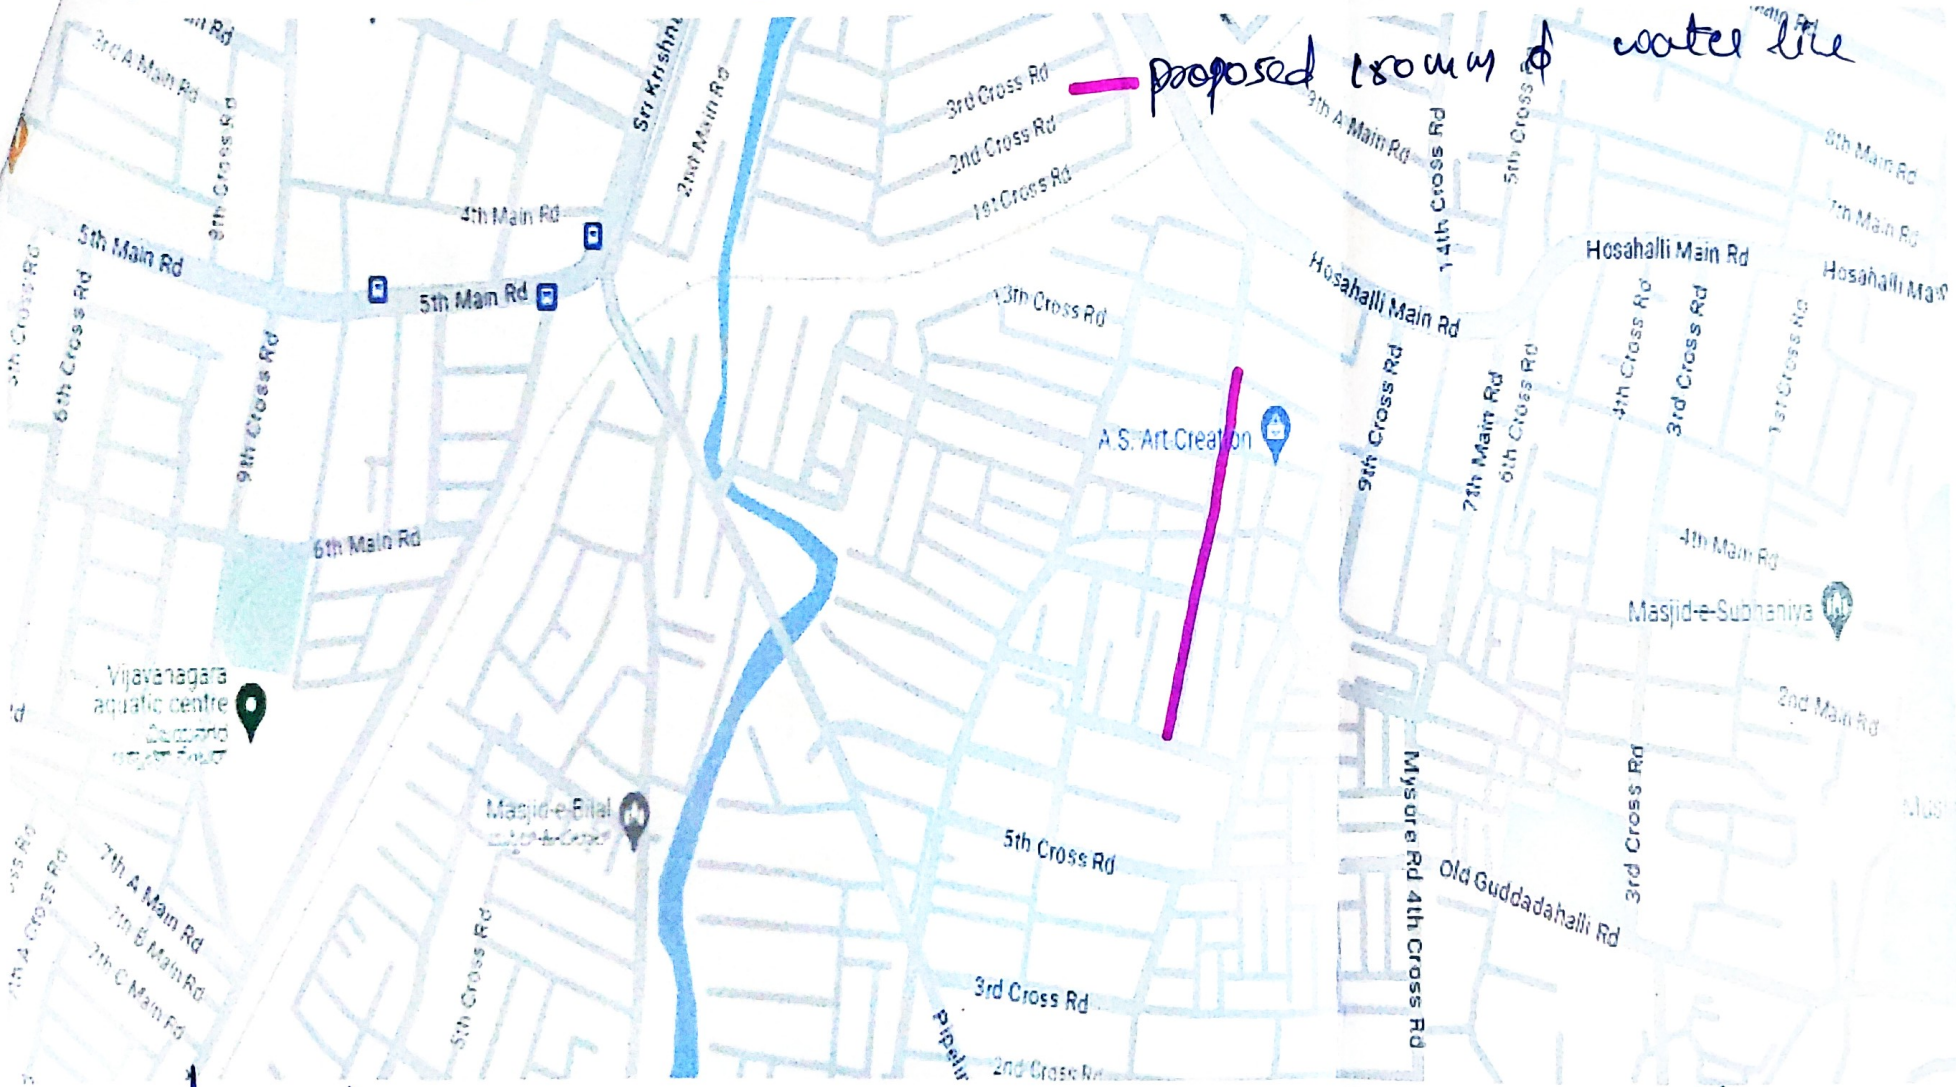

JE JJR

AEESW-2

EESW-1

Scanned with ACE Scanner